



Testing. Advising. Assuring.

## Test report No. 2015-2273

for applying of a required "Verwendbarkeitsnachweis"  
issued 13.01.2016

**Applicant:** Chioccarello SRL  
Viale dell'Industria 4  
36036 Torrebelficino  
ITALIEN

**Date of order:** 06.11.2015  
**Date of sampling:** *no official sampling of the specimen by a representative of Exova Warringtonfire, Frankfurt*  
**Date of arrival:** 11.12.2015  
**Date of test:** 05.01.2016 und 06.01.2016

### Order

Testing of the flammability (building class B1) according to DIN 4102-1 (May 1998)

### Description / designation of the test object

Name of Article: „SUMMANO“

### Description of the relevant test procedure

DIN 4102 part 1 (Mai 1998)

This test report did not replace the required „Verwendbarkeitsnachweis“. It is only used for issuing the "Verwendbarkeitsnachweis".

## 1. Description of the test material

### 1.1 Details of the customer:

Name of Article: „SUMMANO”

Construction:

Colour: yellow  
 Gross weight: 250 g/m<sup>2</sup>  
 Description: 100% Polyester FR

- Plannend are to use (flooring, curtain,...) UPHOLSTERY
- How produced (coated, weaved, ...) COATED
- Thickness: 0,95 mm
- Flame retardant: Our fabric has a flame retardant intrinsic in the fiber
- Producer of flame retardant: I don't know
- Type of flame retardant: I don't know
- Concentration of flame retardant: I don't know
- Adhesive: NO
- Producer of adhesive: NO
- Type of adhesive: NO
- If there are different layers, please provide information for each layer: There is only 1 layer

Intended end use of product: UPHOLSTERY FABRICS

### 1.2 At the specimen preparation by Exova Warringtonfire, Frankfurt determined values:

Fabric material

Colour: yellow  
 Thickness: 0,52 mm  
 Square weight: 252 g/m<sup>2</sup>

Testing after storing 14- days under climatic conditions (23°C / 50 % rel. humidity).

## 2. Test results

### 2.1.1 Brandschachtprüfung according to DIN 4102-1

Sample A: Material tested in production direction  
 Sample B: Material tested crosswise to production direction

Test results of the Brandschacht tests part 1						
line no.		Measurements test sample				
			A	B	C	D
1	<u>no. test arrangement according to DIN 4102 part 15, table 1</u>		1	1		
2	<u>flame height max. over lower sample edge</u> time <sup>1)</sup>	cm	30	30		
		min : s	0:04	0:04		
3	<u>ascertainties on the front side</u> Flaming/glowing time <sup>1)</sup>	min : s	0:03	0:03		
4	<u>melting / burning through</u> time <sup>1)</sup>	min : s	0:06	0:05		
5	<u>ascertainties on the back side</u> Flaming/glowing time <sup>1)</sup> discolouring time <sup>1)</sup>	min : s	no	no		
6		min : s	no	no		
7	<u>burning droplets</u> begin <sup>1)</sup> extent occasional dropping of material constant dropping of material	min : s	not occurred	not occurred		
8						
9						
10	<u>separating from burning sample parts</u> begin <sup>1)</sup> occasional separating parts constant separating parts	min : s	no	no		
11						
12						
13	duration of burning on the sieve tray (max.)	min : s	not occurred	not occurred		
14	<u>influence on the burner flame by dropping of / separating material</u> time <sup>1)</sup>	min : s	no	no		
15	<u>earlier end of test</u> end of the fire scenario on the sample <sup>1)</sup> time of a possible resulted test stop <sup>1)</sup>	min : s	no	no		
16		min : s				

<sup>1)</sup> time from start of test

Test results of the Brandschacht tests part 2						
line no.		Measurements test sample				
		A	B	C	D	
17	<u>flaming after end of test</u> duration	min : s	--/--	--/--		
18	number of sample		--/--	--/--		
19	front side of sample		--/--	--/--		
20	backside of sample		--/--	--/--		
21	flame length	cm	--/--	--/--		
22	<u>glowing after end of test</u> duration	min . s	--/--	--/--		
23	number of sample		--/--	--/--		
	place of occurrence		--/--	--/--		
24	lower sample part		--/--	--/--		
25	upper sample part		--/--	--/--		
26	front side of sample		--/--	--/--		
27	backside of sample		--/--	--/--		
28	<u>smoke density</u> < 400 % x min		4	26		
29	> 440 % x min		--/--	--/--		
30	<u>diagram in annex no.</u>		1	2		
31	<u>residual length</u> single results	cm	70 / 66 72 / 68	70 / 70 70 / 66		
32	average of the single results	cm	69	69		
33	photo of the sample on page		5	5		
34	<u>smoke temperature</u> max. of the average results	°C	116	116		
35	time <sup>1)</sup>	min : s	6:29	9:06		
36	diagram in annex no.		1	2		

<sup>1)</sup> time from start of test

Remarks: Because of the residual length of > 45 cm in two tests, the quantity of tests could be reduced, according to DIN 4102-16.

2.1.2 Appearance of the specimen after the test:



Sample A



Sample B

2.2.1 Normal flammability test according to DIN 4102-1

Test with edge ignition without deposit  
 Flame application on: lower sample edge  
 Edge ignition

Length direction

Sample-no.	1	2	3	4	5
Time from start of test					
Ignition point [s]	1	1	1	1	1
Reaching the measuring mark within 20 seconds	no	no	no	no	no
Self-extinguishing of the flame [s]	9	9	10	10	7
Max. flame height [mm]	40	40	60	60	40
Time [s]	7	7	8	8	5
End of afterflaming [s]	-	-	-	-	-
End of afterglowing [s]	-	-	-	-	-
Flames extinguished after [s]	-	-	-	-	-
Smoke development (visuell impression)	moderate smoke development				
Separating from burning material	no	no	no	no	no
Time [s]	-	-	-	-	-

Remarks: none

Cross direction

Sample-no.	1	2	3	4	5
Time from start of test					
Ignition point [s]	1	1	1	1	1
Reaching the measuring mark within 20 seconds	no	no	no	no	no
Self-extinguishing of the flame [s]	5	4	4	5	4
Max. flame height [mm]	30	30	30	30	30
Time [s]	3	3	3	3	3
End of afterflaming [s]	-	-	-	-	-
End of afterglowing [s]	-	-	-	-	-
Flames extinguished after [s]	-	-	-	-	-
Smoke development (visuell impression)	moderate smoke development				
Separating from burning material	no	no	no	no	no
Time [s]	-	-	-	-	-

Remarks: none

2.2.2 Appearance of the sample after the small burner test:



## Assessment

The material, described in chapter one fulfils the requirements of the building class B2 according to DIN 4102-1 (Mai 1998).

The determined test results show that the material also fulfils the requirements

### of the building class B1

according to DIN 4102-1 (Mai 1998).

## Special comment

The fire test result is only valid for the in chapter one described material in the tested colour and square weight.

The test was carried out in free hanging configuration.

The distance to other plane material must be more or equal then 40 mm.

The material wasn't tested after an outside storage.

In combination with other materials (for example coatings, deposits) the burning behaviour could be influenced unfavourable so that the classification above is not valid any longer. According to DIN 4102-1 the burning behaviour in combination with other materials has to be tested separately.

This test report did not replace the required „Verwendbarkeitsnachweis“. It is only used for issuing the “Verwendbarkeitsnachweis”.

Frankfurt, the 13.01.2016

A handwritten signature in blue ink that reads "Anders".

H. Anders  
Tester in Charge

A handwritten signature in blue ink that reads "Zachäus".

Dipl.-Ing. T. Zachäus  
Laboratory supervisor

This Test report is valid until 04.01.2021

The results of the tests relate only to the behaviour of the test specimen which is designated on the top.



Test reports are only allowed to be published or reproduced, not changed in form and tenor without permission of the Exova Warringtonfire, Frankfurt. The abridged account of a test report is only allowed with the agreement of the Exova Warringtonfire, Frankfurt.

This test report is a translation of the German version 2015-2273 (issued 13.01.2016). In case of doubt only the German version is valid  
This test report contains 8 pages and 2 annexes.



Annex 1 to the Test report No. 2015-2273 issued 13.01.2016

Sample A:

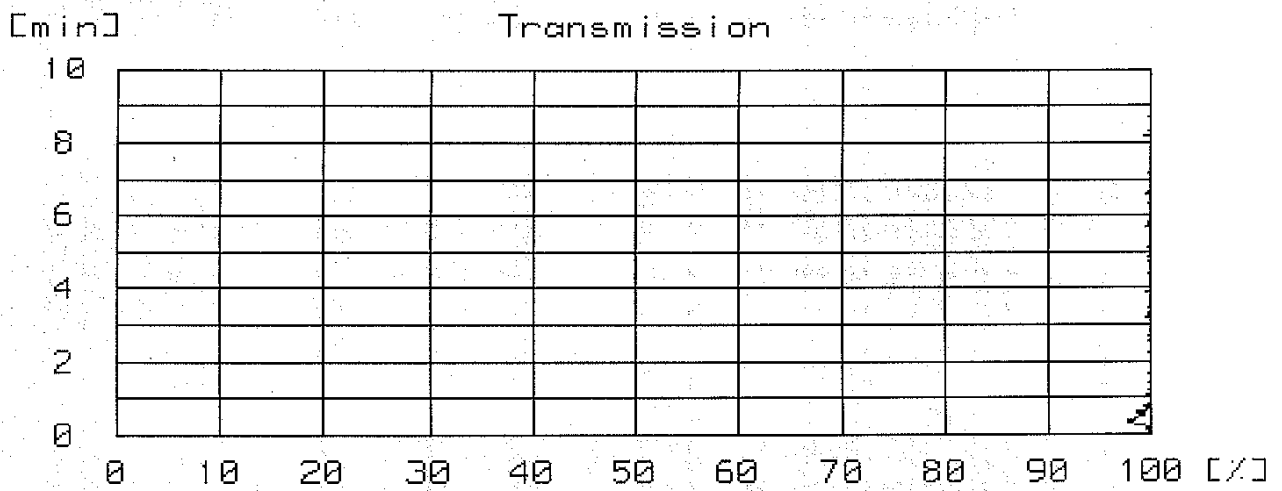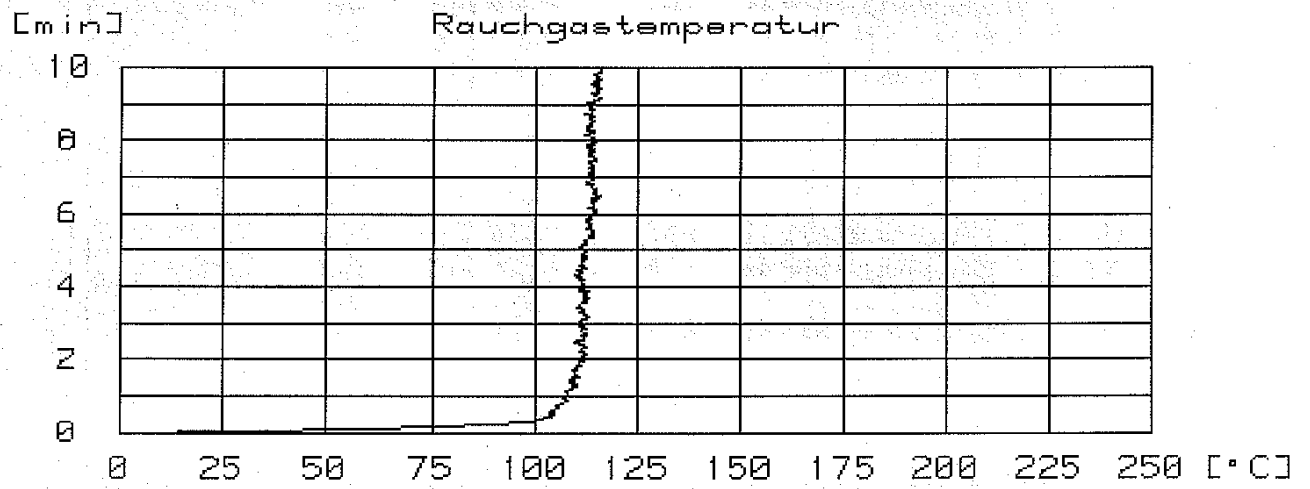

Testing. Advising. Assuring.

Annex 2 to the Test report No. 2015-2273 issued 13.01.2016

Sample B:

